













- Compliance to BS EN/EN50155 and BS EN/EN45545-2 railway standard
- · Width only 32mm
- 2:1 wide input range
- -40~+70°C wide working temperature
- 150% peak load capability
- · DC output adjustable
- · Cooling by free air convection
- Can be installed on DIN rail TS-35/7.5 or 15
- · Protections: Short circuit / Overload / Over voltage / Input reverse polarity / Input under voltage protection
- 4KVdc I/O isolation(Reinforced isolation)
- 3 years warranty











## Applications

- · Bus,tram,metro or railway system
- Industrial control system
- · Semi-conductor fabrication equipment
- Factory automation
- Electro-mechanical
- · Wireless network
- Telecom or datacom system

# Description

DDR-120 series is a 120W DIN Rail type DC-DC converter with main features including DIN rail-type easy installation, ultra slim width (32mm), 2:1 wide input voltage, fanless design, -40~+70°C wide operating temperature, 4KVdc I/O isolation, 150% peak load, adjustable output voltage and full protective functions.

This series of models has various input options: 9~18V / 16.8~33.6V / 33.6~67.2V / 67.2~154V and various output options: 12V / 24V / 48V and can be used for industrial & railway control, security control, communication system and other fields. Suitable applications include DC buck/boost regulator, increasing system insulation level and voltage drop compensation along cable...etc.

# Model Encoding







#### **SPECIFICATION**

MODEL		DDR-120A-12	DDR-120A-24	DDR-120A-48	DDR-120B-12	DDR-120B-24	DDR-120B-48	
	DC VOLTAGE	12V	24V	48V	12V	24V	48V	
	RATED CURRENT	8.3A	4.2A	2.1A	10A	5A	2.5A	
	CURRENT RANGE	0 ~ 8.3A	0~4.2A	0 ~ 2.1A	0 ~ 10A	0 ~ 5A	0 ~ 2.5A	
	RATED POWER	99.6W	100.8W	100.8W	120W	120W	120W	
	PEAK CURRENT			3.15A	15A	7.5A	3.75A	
		150W (3sec.)	1	1 21.121.1	180W (3sec.)			
OUTPUT	RIPPLE & NOISE (max.) Note.2	, ,	50mVp-p	50mVp-p	50mVp-p 50mVp-p 50mVp-p			
0011 01	VOLTAGE ADJ. RANGE	9 ~ 14V	24 ~ 28V	48 ~ 56V	9 ~ 14V	24 ~ 28V	48 ~ 56V	
	VOLTAGE TOLERANCE Note.3		±1.0%	±1.0%	±1.0%	±1.0%	±1.0%	
	LINE REGULATION	±0.5%	±0.5%	±0.5%	±0.5%	±0.5%	±0.5%	
	LOAD REGULATION	±1.0%	±1.0%	±1.0%	±1.0%	±1.0%	±1.0%	
	SETUP, RISE TIME	500ms, 60ms @12V		1.1 (2 )	500ms, 60ms @24	ł V d C		
	HOLD UP TIME (Typ.)		e 7 Hold up Time( Loa					
		9 ~ 18Vdc	9 ~ 18Vdc	9 ~ 18Vdc	16.8 ~ 33.6Vdc	16.8 ~ 33.6Vdc	16.8 ~ 33.6Vdc	
	EFFICIENCY (Typ.)	88.5%	88.5%	88.5%	89%	89.5%	91%	
INPUT	DC CURRENT (Typ.)	11.2A @12Vdc			5.6A @24Vdc			
INFUI	INRUSH CURRENT (Typ.)	5A @12Vdc			5A @ 24Vdc			
	INTERRUPTION OF VOLTAGE OURSELY	EN50155:2007-com	oly with 3ms@ full load	i	EN50155:2007-comply	with S1 level (6ms) @ full lo	ad, S2 level (10ms) @ 70% lo	
	INTERRUPTION OF VOLTAGE SUPPLY	EN50155:2017-com	oly with S1 level		EN50155:2017-cd	mply with S1 level	<del>-</del>	
			•	power for more than 3		onstant current protect	ion 105~135%	
	OVERLOAD	rated output power						
PROTECTION		14.4 ~ 16.8V	28.8 ~ 33.6V	57.6 ~ 67.2V	14.4 ~ 16.8V	28.8 ~ 33.6V	57.6 ~ 67.2V	
T NOTE OTTOR	OVER VOLTAGE			e-power on to recover				
	REVERSE POLARITY	* '		<u> </u>	fault condition removed			
	UNDER VOLTAGE LOCKOUT		er ON≥9V, OFF≤8.			wer ON≥16.8V, OFF	<16.5V	
		-40 ~ +70°C (Refer			24 VIII (D - type) .1 C	wei ON > 10.0V , OI I	<10.5V	
	WORKING TEMP.	,						
	WORKING HUMIDITY	5 ~ 95% RH non-coi						
ENVIRONMENT	,		% RH non-condensing	3				
	TEMP. COEFFICIENT	±0.03%/°C (0 ~ 55			=			
	VIBRATION	Component: 10 ~ 500Hz, 5G 10min./1cycle, 60min. each along X, Y, Z axes; Mounting: Compliance to IEC61373						
	OPERATING ALTITUDE	5000 meters						
	SAFETY STANDARDS	IEC 62368-1, UL 62368-1, EAC TP TC 004, AS/NZS 62368.1 approved; Design refer to UL508						
	WITHSTAND VOLTAGE	I/P-O/P:4KVdc I/P-FG:2.5KVdc O/P-FG:2.5KVdc						
	ISOLATION RESISTANCE	I/P-O/P, I/P-FG, O/F	-FG:>100M Ohms / 5	00Vdc / 25°C / 70% RI	<u>H</u>			
		Parameter Standard Test Level / Note						
		Conducted BS EN/EN55032 Class B		В				
	EMC EMISSION	Radiated BS EN/EN55032 Class B						
	EMC EMISSION	rtudiatou		BS EN/EN55032	Class	В		
	EMC EMISSION	Voltage Flicker		BS EN/EN55032 BS EN/EN61000-3		В		
SAFETY &	EMC EMISSION					В		
EMC	EMC EMISSION	Voltage Flicker Harmonic Current	S EN/EN61000-6-2(E	BS EN/EN61000-3	-3	В		
EMC	EMC EMISSION	Voltage Flicker Harmonic Current BS EN/EN55024 , B	S EN/EN61000-6-2(E	BS EN/EN61000-3	-3			
EMC	EMC EMISSION	Voltage Flicker Harmonic Current BS EN/EN55024 , B Parameter	S EN/EN61000-6-2(E	BS EN/EN61000-3  S EN/EN50082-2) Standard	-3  Test L	evel / Note	V contact: critaria ∆	
EMC	EMC EMISSION	Voltage Flicker Harmonic Current BS EN/EN55024 , B Parameter ESD	S EN/EN61000-6-2(E	BS EN/EN61000-3 S EN/EN50082-2) Standard BS EN/EN61000-4	-3 Test L	evel / Note 3, 8KV air ; Level 3, 6K	V contact; criteria A	
EMC	EMC EMISSION	Voltage Flicker Harmonic Current BS EN/EN55024 , B Parameter ESD Radiated	S EN/EN61000-6-2(E	BS EN/EN61000-3 S EN/EN50082-2) Standard BS EN/EN61000-4 BS EN/EN61000-4	-3 Test L -2 Level -3 Level	evel / Note 3, 8KV air ; Level 3, 6K 3, 10V/m ; criteria A	V contact; criteria A	
EMC	EMC IMMUNITY	Voltage Flicker Harmonic Current BS EN/EN55024, B Parameter ESD Radiated EFT / Burst	S EN/EN61000-6-2(E	BS EN/EN61000-3 S EN/EN50082-2) Standard BS EN/EN61000-4 BS EN/EN61000-4 BS EN/EN61000-4	-3 Test L -2 Level -3 Level -4 Level	evel / Note 3, 8KV air ; Level 3, 6K 3, 10V/m ; criteria A 3, 2KV ; criteria A	·	
EMC		Voltage Flicker Harmonic Current BS EN/EN55024 , B Parameter ESD Radiated EFT / Burst Surge	S EN/EN61000-6-2(E	BS EN/EN61000-3 S EN/EN50082-2) Standard BS EN/EN61000-4 BS EN/EN61000-4 BS EN/EN61000-4 BS EN/EN61000-4	-3 Test L -2 Level -3 Level -4 Level -5 Level 3	evel / Note 3, 8KV air ; Level 3, 6K 3, 10V/m ; criteria A 3, 2KV ; criteria A 1KV/Line-Line ; Level 3, 2		
EMC		Voltage Flicker Harmonic Current BS EN/EN55024, B Parameter ESD Radiated EFT / Burst Surge Conducted	S EN/EN61000-6-2(E	BS EN/EN61000-3 SS EN/EN50082-2) Standard BS EN/EN61000-4 BS EN/EN61000-4 BS EN/EN61000-4 BS EN/EN61000-4 BS EN/EN61000-4	-3 Test L -2 Level -3 Level -4 Level -5 Level 3	evel / Note 3, 8KV air ; Level 3, 6K 3, 10V/m ; criteria A 3, 2KV ; criteria A 1KV/Line-Line ;Level 3, 3		
EMC		Voltage Flicker Harmonic Current BS EN/EN55024 , B Parameter ESD Radiated EFT / Burst Surge	S EN/EN61000-6-2(E	BS EN/EN61000-3 S EN/EN50082-2) Standard BS EN/EN61000-4 BS EN/EN61000-4 BS EN/EN61000-4 BS EN/EN61000-4	-3 Test L -2 Level -3 Level -4 Level -5 Level 3	evel / Note 3, 8KV air ; Level 3, 6K 3, 10V/m ; criteria A 3, 2KV ; criteria A 1KV/Line-Line ; Level 3, 2	V contact; criteria A 2KV/Line-Line-FG ;criteria	
EMC	EMC IMMUNITY	Voltage Flicker Harmonic Current BS EN/EN55024, B Parameter ESD Radiated EFT / Burst Surge Conducted Magnetic Field Compliance to BS E	N/EN45545-2 for fire p	BS EN/EN61000-3 SS EN/EN50082-2) Standard BS EN/EN61000-4 BS EN/EN61000-4 BS EN/EN61000-4 BS EN/EN61000-4 BS EN/EN61000-4 BS EN/EN61000-4 DOTO TO	-3 Test L -2 Level -3 Level -4 Level -5 Level 3 -6 Level	evel / Note 3, 8KV air ; Level 3, 6K 3, 10V/m ; criteria A 3, 2KV ; criteria A 1KV/Line-Line ;Level 3, 3	2KV/Line-Line-FG ;criteria .	
EMC	EMC IMMUNITY  RAILWAY STANDARD	Voltage Flicker Harmonic Current BS EN/EN55024, B Parameter ESD Radiated EFT / Burst Surge Conducted Magnetic Field Compliance to BS E BS EN/EN50121-3-	N/EN45545-2 for fire p 2 for EMC (except foi	BS EN/EN61000-3 SS EN/EN50082-2) Standard BS EN/EN61000-4	-3 Test L -2 Level -3 Level -4 Level -5 Level 3 -6 Level	evel / Note 3, 8KV air ; Level 3, 6K 3, 10V/m ; criteria A 3, 2KV ; criteria A 1KV/Line-Line ;Level 3, 2 3, 10V ; criteria A 4, 30A/m ; criteria A	2KV/Line-Line-FG ;criteria	
EMC	EMC IMMUNITY	Voltage Flicker Harmonic Current BS EN/EN55024, B Parameter ESD Radiated EFT / Burst Surge Conducted Magnetic Field Compliance to BS E BS EN/EN50121-3-	N/EN45545-2 for fire p	BS EN/EN61000-3 SS EN/EN50082-2) Standard BS EN/EN61000-4	-3 Test L -2 Level -3 Level -4 Level -5 Level 3 -6 Level	evel / Note 3, 8KV air ; Level 3, 6K 3, 10V/m ; criteria A 3, 2KV ; criteria A 1KV/Line-Line ;Level 3, 2 3, 10V ; criteria A 4, 30A/m ; criteria A	2KV/Line-Line-FG ;criteria	
EMC (Note 6)	EMC IMMUNITY  RAILWAY STANDARD	Voltage Flicker Harmonic Current BS EN/EN55024, B Parameter ESD Radiated EFT / Burst Surge Conducted Magnetic Field Compliance to BS E BS EN/EN50121-3-	N/EN45545-2 for fire p 2 for EMC (except for MIL-HDBK-217F (25°C	BS EN/EN61000-3 SS EN/EN50082-2) Standard BS EN/EN61000-4	-3 Test L -2 Level -3 Level -4 Level -5 Level 3 -6 Level	evel / Note 3, 8KV air ; Level 3, 6K 3, 10V/m ; criteria A 3, 2KV ; criteria A 1KV/Line-Line ;Level 3, 2 3, 10V ; criteria A 4, 30A/m ; criteria A	2KV/Line-Line-FG ;criteria	
EMC Note 6)	EMC IMMUNITY  RAILWAY STANDARD  MTBF	Voltage Flicker Harmonic Current BS EN/EN55024, B Parameter ESD Radiated EFT / Burst Surge Conducted Magnetic Field Compliance to BS E BS EN/EN50121-3- 214.6K hrs min.	N/EN45545-2 for fire p 2 for EMC (except for MIL-HDBK-217F (25°C V*H*D)	BS EN/EN61000-3 SS EN/EN50082-2) Standard BS EN/EN61000-4	-3 Test L -2 Level -3 Level -4 Level -5 Level 3 -6 Level	evel / Note 3, 8KV air ; Level 3, 6K 3, 10V/m ; criteria A 3, 2KV ; criteria A 1KV/Line-Line ;Level 3, 2 3, 10V ; criteria A 4, 30A/m ; criteria A	2KV/Line-Line-FG ;criteria	
EMC (Note 6)	EMC IMMUNITY  RAILWAY STANDARD  MTBF  DIMENSION	Voltage Flicker Harmonic Current BS EN/EN55024 , B Parameter ESD Radiated EFT / Burst Surge Conducted Magnetic Field Compliance to BS E BS EN/EN50121-3- 214.6K hrs min. I 32*125.2*102mm (V 510g; 28pcs/15.3Kg	N/EN45545-2 for fire p 2 for EMC (except for MIL-HDBK-217F (25°0 V*H*D) /1.22CUFT	BS EN/EN61000-3 SS EN/EN50082-2) Standard BS EN/EN61000-4 BS EN/EN61000-4 BS EN/EN61000-4 BS EN/EN61000-4 BS EN/EN61000-4 BS EN/EN61000-4 Corotection; Meet BS E-9~18Vin)	-32 Level -3 Level -4 Level -5 Level -6 Level -8 Level	evel / Note 3, 8KV air ; Level 3, 6K 3, 10V/m ; criteria A 3, 2KV ; criteria A ,1KV/Line-Line ;Level 3, 3 3, 10V ; criteria A 4, 30A/m ; criteria A 71 including IEC61373	2KV/Line-Line-FG ;criteria	
EMC (Note 6)	EMC IMMUNITY  RAILWAY STANDARD  MTBF  DIMENSION  PACKING  1. All parameters NOT spec	Voltage Flicker Harmonic Current BS EN/EN55024 , B Parameter ESD Radiated EFT / Burst Surge Conducted Magnetic Field Compliance to BS E BS EN/EN50121-3- 214.6K hrs min. I 32*125.2*102mm (V 510g; 28pcs/15.3Kg ially mentioned are	N/EN45545-2 for fire p 2 for EMC (except for MIL-HDBK-217F (25°C V*H*D) /1.22CUFT measured at norm	BS EN/EN61000-3 SS EN/EN50082-2) Standard BS EN/EN61000-4 BS EN/EN61000-4 BS EN/EN61000-4 BS EN/EN61000-4 BS EN/EN61000-4 BS EN/EN61000-4 BS EN/EN61000-5 Orotection; Meet BS En/EN61000-4 Contact on; Meet BS En/En/En/En/En/En/En/En/En/En/En/En/En/E	-32 Level -3 Level -4 Level -5 Level -6 Level -8 Level N/EN50155 / IEC605	evel / Note 3, 8KV air; Level 3, 6K 3, 10V/m; criteria A 3, 2KV; criteria A ,1KV/Line-Line; Level 3, 3 3, 10V; criteria A 4, 30A/m; criteria A 71 including IEC61373	2KV/Line-Line-FG ;criteria for shock & vibration, ient temperature.	
EMC Note 6)	EMC IMMUNITY  RAILWAY STANDARD  MTBF  DIMENSION  PACKING	Voltage Flicker Harmonic Current BS EN/EN55024 , B Parameter ESD Radiated EFT / Burst Surge Conducted Magnetic Field Compliance to BS E BS EN/EN50121-3- 214.6K hrs min. I 32*125.2*102mm (V 510g; 28pcs/15.3Kg ially mentioned are ured at 20MHz of b	N/EN45545-2 for fire p 2 for EMC (except for MIL-HDBK-217F (25°C V*H*D) /1.22CUFT measured at norm andwidth by using a	BS EN/EN61000-3 S EN/EN50082-2) Standard BS EN/EN61000-4 BS EN/EN61000-4 BS EN/EN61000-4 BS EN/EN61000-4 BS EN/EN61000-4 BS EN/EN61000-4 Corrotection; Meet BS E 19~18Vin) C) al input (A:12Vdc , a 12" twisted pair-w	-32 Level -3 Level -4 Level -5 Level -6 Level -8 Level N/EN50155 / IEC605	evel / Note 3, 8KV air; Level 3, 6K 3, 10V/m; criteria A 3, 2KV; criteria A ,1KV/Line-Line; Level 3, 3 3, 10V; criteria A 4, 30A/m; criteria A 71 including IEC61373	2KV/Line-Line-FG ;criteria for shock & vibration, ient temperature.	
EMC Note 6)	EMC IMMUNITY  RAILWAY STANDARD  MTBF  DIMENSION  PACKING  1. All parameters NOT spec 2. Ripple & noise are measured.	Voltage Flicker Harmonic Current BS EN/EN55024 , B Parameter ESD Radiated EFT / Burst Surge Conducted Magnetic Field Compliance to BS E BS EN/EN50121-3- 214.6K hrs min. I 32*125.2*102mm (V 510g; 28pcs/15.3Kg ially mentioned are ured at 20MHz of but tolerance, line re	N/EN45545-2 for fire p 2 for EMC (except for MIL-HDBK-217F (25°C V*H*D) /1.22CUFT measured at norm andwidth by using a gulation and load re	BS EN/EN61000-3  SEN/EN50082-2)  Standard  BS EN/EN61000-4  BS EN/EN61000-4  BS EN/EN61000-4  BS EN/EN61000-4  BS EN/EN61000-4  BS EN/EN61000-4  Corotection; Meet BS E 9~18Vin)  C)  al input (A:12Vdc , a 12" twisted pair-wegulation.	Test L -2 Level -3 Level -4 Level -5 Level -8 Level N/EN50155 / IEC605	evel / Note 3, 8KV air; Level 3, 6K 3, 10V/m; criteria A 3, 2KV; criteria A ,1KV/Line-Line; Level 3, 3 3, 10V; criteria A 4, 30A/m; criteria A 71 including IEC61373	2KV/Line-Line-FG ;criteria for shock & vibration, ient temperature.	
EMC (Note 6)	EMC IMMUNITY  RAILWAY STANDARD  MTBF  DIMENSION  PACKING  1. All parameters NOT spec 2. Ripple & noise are measi 3. Tolerance: includes set u	Voltage Flicker Harmonic Current BS EN/EN55024 , B Parameter ESD Radiated EFT / Burst Surge Conducted Magnetic Field Compliance to BS E BS EN/EN50121-3- 214.6K hrs min. I 32*125.2*102mm (V 510g; 28pcs/15.3Kg ially mentioned are ured at 20MHz of but p tolerance, line reunder low input vol	N/EN45545-2 for fire p 2 for EMC (except for MIL-HDBK-217F (25°C V*H*D) /1.22CUFT measured at norm andwidth by using a gulation and load re tage. Please check	BS EN/EN61000-3  SEN/EN50082-2)  Standard  BS EN/EN61000-4  BS EN/EN61000-4  BS EN/EN61000-4  BS EN/EN61000-4  BS EN/EN61000-4  BS EN/EN61000-4  Corotection; Meet BS E 9~18Vin)  C)  al input (A:12Vdc , a 12" twisted pair-wegulation.	Test L -2 Level -3 Level -4 Level -5 Level -8 Level N/EN50155 / IEC605	evel / Note 3, 8KV air; Level 3, 6K 3, 10V/m; criteria A 3, 2KV; criteria A ,1KV/Line-Line; Level 3, 3 3, 10V; criteria A 4, 30A/m; criteria A 71 including IEC61373	2KV/Line-Line-FG ;criteria for shock & vibration, ient temperature.	
EMC (Note 6)	EMC IMMUNITY  RAILWAY STANDARD  MTBF  DIMENSION  PACKING  1. All parameters NOT spec 2. Ripple & noise are measu 3. Tolerance: includes set u 4. Derating may be needed	Voltage Flicker Harmonic Current BS EN/EN55024 , B Parameter ESD Radiated EFT / Burst Surge Conducted Magnetic Field Compliance to BS E BS EN/EN50121-3- 214.6K hrs min. I 32*125.2*102mm (V 510g; 28pcs/15.3Kg ially mentioned are ured at 20MHz of b up tolerance, line re under low input vol efer to peak loading	N/EN45545-2 for fire p 2 for EMC (except for MIL-HDBK-217F (25°C V*H*D) /1.22CUFT measured at norm andwidth by using a gulation and load re tage. Please check g curves.	BS EN/EN61000-3 S EN/EN50082-2) Standard BS EN/EN61000-4 BS EN/EN61000-4 BS EN/EN61000-4 BS EN/EN61000-4 BS EN/EN61000-4 BS EN/EN61000-4 Corrotection; Meet BS En/EN61000-4 Drotection; Meet BS En/En/En/En/En/En/En/En/En/En/En/En/En/E	Test L -2 Level -3 Level -4 Level -5 Level -8 Level N/EN50155 / IEC605	evel / Note 3, 8KV air; Level 3, 6K 3, 10V/m; criteria A 3, 2KV; criteria A 1KV/Line-Line; Level 3, 3 3, 10V; criteria A 4, 30A/m; criteria A 71 including IEC61373 ad and 25°C of amb a 0.1 μ f & 47 μ f pai	2KV/Line-Line-FG ;criteria for shock & vibration, ient temperature. rallel capacitor.	
EMC (Note 6)	EMC IMMUNITY  RAILWAY STANDARD  MTBF  DIMENSION  PACKING  1. All parameters NOT spectors are measured as a consistent of the specific spec	Voltage Flicker Harmonic Current BS EN/EN55024 , B Parameter ESD Radiated EFT / Burst Surge Conducted Magnetic Field Compliance to BS E BS EN/EN50121-3- 214.6K hrs min. I 32*125.2*102mm (V 510g; 28pcs/15.3Kg ially mentioned are ured at 20MHz of b up tolerance, line re under low input vol efer to peak loading idered as an indep	N/EN45545-2 for fire p 2 for EMC (except for MIL-HDBK-217F (25°0 V*H*D) /1.22CUFT measured at norm andwidth by using a gulation and load re tage. Please check g curves. endent unit, but the	BS EN/EN61000-3  SEN/EN50082-2)  Standard  BS EN/EN61000-4  BS EN/EN61000-4  BS EN/EN61000-4  BS EN/EN61000-4  BS EN/EN61000-4  BS EN/EN61000-4  BS EN/EN61000-6  CONTROL OF THE SEN OF THE	Test L -2 Level -3 Level -4 Level -5 Level -8 Level N/EN50155 / IEC605  B:24Vdc) , rated loaire terminated with for more details.	evel / Note 3, 8KV air; Level 3, 6K 3, 10V/m; criteria A 3, 2KV; criteria A ,1KV/Line-Line; Level 3, 3 3, 10V; criteria A 4, 30A/m; criteria A 71 including IEC61373 ad and 25°C of amble a 0.1 \( \mu \) f & 47 \( \mu \) f paid	2KV/Line-Line-FG ;criteria  for shock & vibration,  ient temperature. rallel capacitor.  em complies with	
EMC (Note 6)	EMC IMMUNITY  RAILWAY STANDARD  MTBF  DIMENSION  PACKING  1. All parameters NOT spectors are measured as a consideration of the conside	Voltage Flicker Harmonic Current BS EN/EN55024 , B Parameter ESD Radiated EFT / Burst Surge Conducted Magnetic Field Compliance to BS E BS EN/EN50121-3- 214.6K hrs min. I 32*125.2*102mm (V 510g; 28pcs/15.3Kg ially mentioned are ured at 20MHz of b up tolerance, line re under low input vol efer to peak loading idered as an indep juidance on how to	N/EN45545-2 for fire p 2 for EMC (except for MIL-HDBK-217F (25°0 V*H*D) /1.22CUFT measured at norm andwidth by using a gulation and load re tage. Please check g curves. endent unit, but the	BS EN/EN61000-3  SEN/EN50082-2)  Standard  BS EN/EN61000-4  BS EN/EN61000-4  BS EN/EN61000-4  BS EN/EN61000-4  BS EN/EN61000-4  BS EN/EN61000-4  BS EN/EN61000-6  CONTROL OF THE SEN OF THE	Test L -2 Level -3 Level -4 Level -5 Level -8 Level N/EN50155 / IEC605  B:24Vdc) , rated loaire terminated with for more details.	evel / Note 3, 8KV air; Level 3, 6K 3, 10V/m; criteria A 3, 2KV; criteria A ,1KV/Line-Line; Level 3, 3 3, 10V; criteria A 4, 30A/m; criteria A 71 including IEC61373 ad and 25°C of amble a 0.1 \( \mu \) f & 47 \( \mu \) f paid	2KV/Line-Line-FG ;criteria  for shock & vibration,  ient temperature. rallel capacitor.  em complies with	
EMC (Note 6)	EMC IMMUNITY  RAILWAY STANDARD  MTBF  DIMENSION  PACKING  1. All parameters NOT spectors are measured as a consistent of the specific spec	Voltage Flicker Harmonic Current BS EN/EN55024 , B Parameter ESD Radiated EFT / Burst Surge Conducted Magnetic Field Compliance to BS E BS EN/EN50121-3- 214.6K hrs min. 32*125.2*102mm (V 510g; 28pcs/15.3Kg ially mentioned are ured at 20MHz of b up tolerance, line re under low input vol efer to peak loading idered as an indep juidance on how to v.meanwell.com)	N/EN45545-2 for fire p 2 for EMC (except for MIL-HDBK-217F (25°C) V*H*D) /1.22CUFT measured at norm andwidth by using a gulation and load re tage. Please check g curves. endent unit, but the perform these EMC	BS EN/EN61000-3  SEN/EN50082-2)  Standard  BS EN/EN61000-4  Correction; Meet BS Encycle (12)  Twisted pair-wegulation.  The derating curve  final equipment still correction; please reference (1)	Test L Level Level Level Level Level Level Level Level Level R/EN50155 / IEC605  B:24Vdc) , rated loaire terminated with for more details.	evel / Note 3, 8KV air; Level 3, 6K 3, 10V/m; criteria A 3, 2KV; criteria A 1, 1KV/Line-Line; Level 3, 3 3, 10V; criteria A 4, 30A/m; criteria A 71 including IEC61373 ad and 25°C of amb a 0.1 μ f & 47 μ f paragraphs at that the whole systemponent power su	for shock & vibration,  fent temperature. rallel capacitor.  em complies with upplies."	
EMC (Note 6)	EMC IMMUNITY  RAILWAY STANDARD  MTBF  DIMENSION  PACKING  1. All parameters NOT spectors are measured as a consideration of the consideration of the consideration of the power supply is consideration of the EMC directives. For consideration of the consideration	Voltage Flicker Harmonic Current BS EN/EN55024 , B Parameter ESD Radiated EFT / Burst Surge Conducted Magnetic Field Compliance to BS E BS EN/EN50121-3- 214.6K hrs min. 32*125.2*102mm (V 510g; 28pcs/15.3Kg ially mentioned are ured at 20MHz of b up tolerance, line re under low input vol efer to peak loading idered as an indep juidance on how to v.meanwell.com)	N/EN45545-2 for fire p 2 for EMC (except for MIL-HDBK-217F (25°C) V*H*D) /1.22CUFT measured at norm andwidth by using a gulation and load re tage. Please check g curves. endent unit, but the perform these EMC	BS EN/EN61000-3  SEN/EN50082-2)  Standard  BS EN/EN61000-4  Correction; Meet BS Encycle (12)  Twisted pair-wegulation.  The derating curve  final equipment still correction; please reference (1)	Test L Level Level Level Level Level Level Level Level Level R/EN50155 / IEC605  B:24Vdc) , rated loaire terminated with for more details.	evel / Note 3, 8KV air; Level 3, 6K 3, 10V/m; criteria A 3, 2KV; criteria A 1, 1KV/Line-Line; Level 3, 3 3, 10V; criteria A 4, 30A/m; criteria A 71 including IEC61373 ad and 25°C of amb a 0.1 μ f & 47 μ f paragraphs at that the whole systemponent power su	for shock & vibration,  fent temperature. rallel capacitor.  em complies with upplies."	





#### **SPECIFICATION**

MODEL		DDR-120C-12	DDR-120C-24	DDR-120C-48	DDR-120D-12	DDR-120D-24	DDR-120D-48	
	DC VOLTAGE	12V	24V	48V	12V	24V	48V	
	RATED CURRENT	10A	5A	2.5A	10A	5A	2.5A	
	CURRENT RANGE	0 ~ 10A	0 ~ 5A	0 ~ 2.5A	0 ~ 10A	0 ~ 5A	0 ~ 2.5A	
	RATED POWER	120W	120W	120W	120W	120W	120W	
	PEAK CURRENT	15A	7.5A	3.75A	15A	7.5A	3.75A	
		180W (3sec.)						
OUTPUT	RIPPLE & NOISE (max.) Note.2	` '	50mVp-p	50mVp-p	50mVp-p	50mVp-p	50mVp-p	
0011 01	VOLTAGE ADJ. RANGE	9 ~ 14V	24 ~ 28V	48 ~ 56V	9 ~ 14V	24 ~ 28V	48 ~ 56V	
	VOLTAGE TOLERANCE Note.3		±1.0%	±1.0%	±1.0%	±1.0%	±1.0%	
		±0.5%			±0.5%	±0.5%		
	LINE REGULATION		±0.5%	±0.5%			±0.5%	
	LOAD REGULATION	±1.0%	±1.0%	±1.0%	±1.0%	±1.0%	±1.0%	
	SETUP, RISE TIME	500ms, 60ms @48Vdc			500ms, 60ms @110Vdc			
	HOLD UP TIME (Typ.)	Please refer to pa	ige 7 Hold up Time( L	oad de-rating curve)				
	VOLTAGE RANGE Note.4	33.6 ~ 67.2Vdc	33.6 ~ 67.2Vdc	33.6 ~ 67.2Vdc	67.2 ~ 154Vdc	67.2 ~ 154Vdc	67.2 ~ 154Vdc	
	EFFICIENCY (Typ.)	89.5%	91%	92%	89.5%	91%	91.5%	
	DC CURRENT (Typ.)	2.8A @48Vdc			1.3A @110Vdc			
NPUT	INRUSH CURRENT (Typ.)	5A @48Vdc			5A @110Vdc			
		EN50155:2007-comply	with S1 level (6ms) @ full lo	ad. S2 level (10ms) @ 60% lo	ad EN50155:2007-comply with S2 level (10ms) @ full load			
	INTERRUPTION OF VOLTAGE SUPPLY	EN50155:2017-comply with S1 level  EN50155:2017-comply with S1 level  EN50155:2017-comply with S1 level				, @		
	OVERLOAD	Normally works w		t power for more than	_	constant current protect	tion 105~135%	
PROTECTION		14.4 ~ 16.8V	28.8 ~ 33.6V	57.6 ~ 67.2V	14.4 ~ 16.8V	28.8 ~ 33.6V	57.6 ~ 67.2V	
FROILCHON	OVER VOLTAGE			re-power on to recove		20.0 00.00	01.0 01.24	
	REVERSE POLARITY	• • • • • • • • • • • • • • • • • • • •		•		ıod		
	UNDER VOLTAGE LOCKOUT	-			ault condition removed  110Vin (D - type):Power ON ≥67.2V , OFF ≤65V			
			wer ON≥33.6V, OFF	· ≈ 33V	TTOVIN (D - type):	Power ON > 67.2V, OF	F < 00 V	
	WORKING TEMP.	`	er to "Derating Curve")					
	WORKING HUMIDITY	5 ~ 95% RH non-o						
ENVIRONMENT	STORAGE TEMP., HUMIDITY	-40 ~ +85°C, 5 ~ 95% RH non-condensing						
	TEMP. COEFFICIENT	±0.03%/°C (0~55°C)						
	VIBRATION	Component:10 ~ 500Hz, 5G 10min./1cycle, 60min. each along X, Y, Z axes; Mounting: Compliance to IEC61373						
	OPERATING ALTITUDE	5000 meters						
	SAFETY STANDARDS	IEC 62368-1, UL 62368-1, EAC TP TC 004, AS/NZS 62368.1 approved; Design refer to UL508						
	WITHSTAND VOLTAGE	I/P-O/P:4KVdc	I/P-FG:2.5KVdc O/F	P-FG:2.5KVdc				
	ISOLATION RESISTANCE	I/P-O/P. I/P-FG. C	/P-FG:>100M Ohms /	500Vdc / 25°C / 70% R	RH			
		Parameter		Standard	Test Level / Note			
		Conducted		BS EN/EN55032	Class			
	EMC EMISSION	Radiated BS EN/EN55032			Class B			
	EWIC EWISSION					5 D		
SAFETY &		Voltage Flicker		BS EN/EN61000-				
EMC		Harmonic Current						
Note 6)		BS EN/EN55024 , BS EN/EN61000-6-2(BS EN/EN50082-2)						
	EMC IMMUNITY	Parameter Standard		Test Level / Note				
		ESD BS EN/EN6100		BS EN/EN61000-	4-2 Leve	l 3, 8KV air ; Level 3, 6h	, 8KV air ; Level 3, 6KV contact; criteria A	
		Radiated BS EN/EN61000-4-3 Level 3, 10V/m; criteria A		I 3, 10V/m ; criteria A	1			
		EFT / Burst	EFT / Burst BS EN/EN61000-4-4 Level 3, 2KV ; criteria A					
				I 3, 1KV/Line-Line ;Level 3, 2KV/Line-Line-FG ;crite				
		Conducted						
		Magnetic Field BS EN/EN61000-4-8 Level 4, 30A/m; criteria A						
	DAILWAY CTANDADD		EN/EN/455/5 2 for fire					
	RAILWAY STANDARD	Compliance to BS EN/EN45545-2 for fire protection; Meet BS EN/EN50155 / IEC60571 including IEC61373 for shock & vibration, BS EN/EN50121-3-2 for EMC						
	MTBF	BS EN/EN50121-3-2 for EMC						
OTHERS		214.6K hrs min. MIL-HDBK-217F (25°C)						
OTHERS	DIMENSION	32*125.2*102mm (W*H*D)						
	PACKING	510g; 28pcs/15.3Kg/1.22CUFT						
IOTE	Ripple & noise are measure     Tolerance: includes set up     Derating may be needed u     S seconds max., please ref	cially mentioned are measured at normal input (C:48Vdc , D:110Vdc) , rated load and 25°C of ambient temperature. Sured at 20MHz of bandwidth by using a 12" twisted pair-wire terminated with a 0.1 $\mu$ f & 47 $\mu$ f parallel capacitor. Up tolerance, line regulation and load regulation. In during the derivative for more details. In the derivative for more details are peak loading curves. In parallel capacitor, with the final equipment still need to re-confirm that the whole system complies with						
	the EMC directives. For control (as available on http://www 7. The ambient temperature 2000m(6500ft).	guidance on how w.meanwell.com)	to perform these EM	IC tests, please refe	r to "EMI testing of	component power s	upplies."	








 $\begin{tabular}{ll} \hline $\times$ Product Liability Disclaimer: For detailed information, please refer to $https://www.meanwell.com/serviceDisclaimer.aspx \end{tabular}$ 



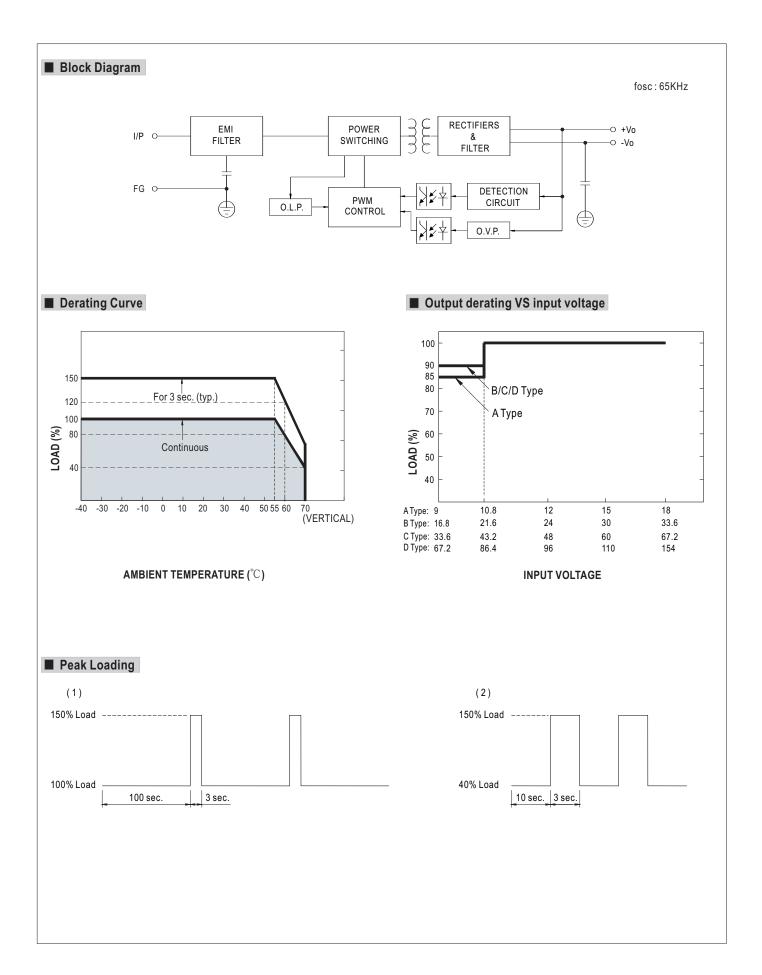




#### ■ Input Fuse


There is a fuse connected in series to the positive input line, which is used to protect against abnormal surge. Fuse specifications of each model are shown as below.

Туре	Fuse Type	Reference and Rating
Α	Time-Lag	Conquer MST, 10A, 250V *2
В	Time-Lag	Conquer MST, 8A, 250V *2
С	Time-Lag	Conquer MST, 8A, 250V *1
D	Time-Lag	Conquer MST, 4A, 250V *1


### ■ Input Under-Voltage Protection

If input voltage drops below Vimin, the internal control IC shuts down and there is no output voltage. It recovers automatically when input voltage reaches above Vimin, please refer to the cruve below.




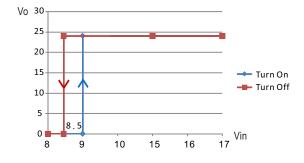


#### DDR-120B-24



### DDR-120C-24

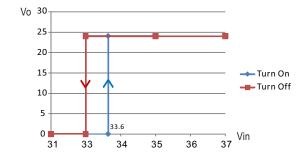

### DDR-120D-24





## ■ Input Reverse Polarity Protection


There is a MOSFET connected in series to the negative input line. If the input polarity is connected reversely, the MOSFET opens and there will be no output to protect the unit.

## ■ Input Range and Transient Ability


The series has a wide range input capability. With -30% / +40% of rated input voltage(except A Type), it can withstand that for 1 second.

#### **■** Inrush Current

Inrush current is suppressed by a current limit circuit during the initial start-up, and then the circuit is bypassed by a MOSFET to reduce power consumption after accomplishing the start-up.






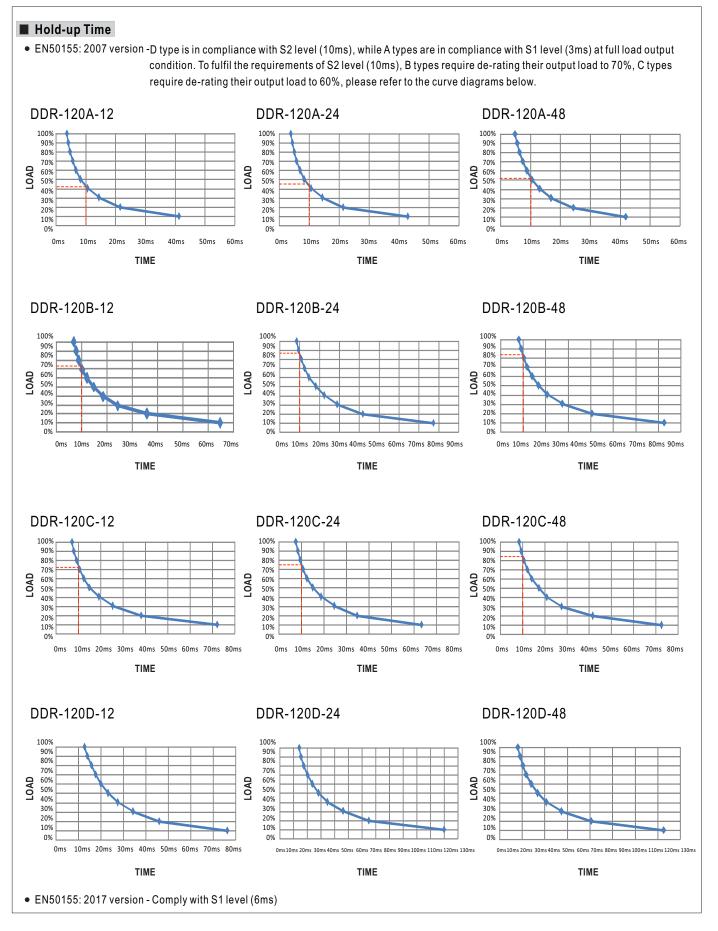





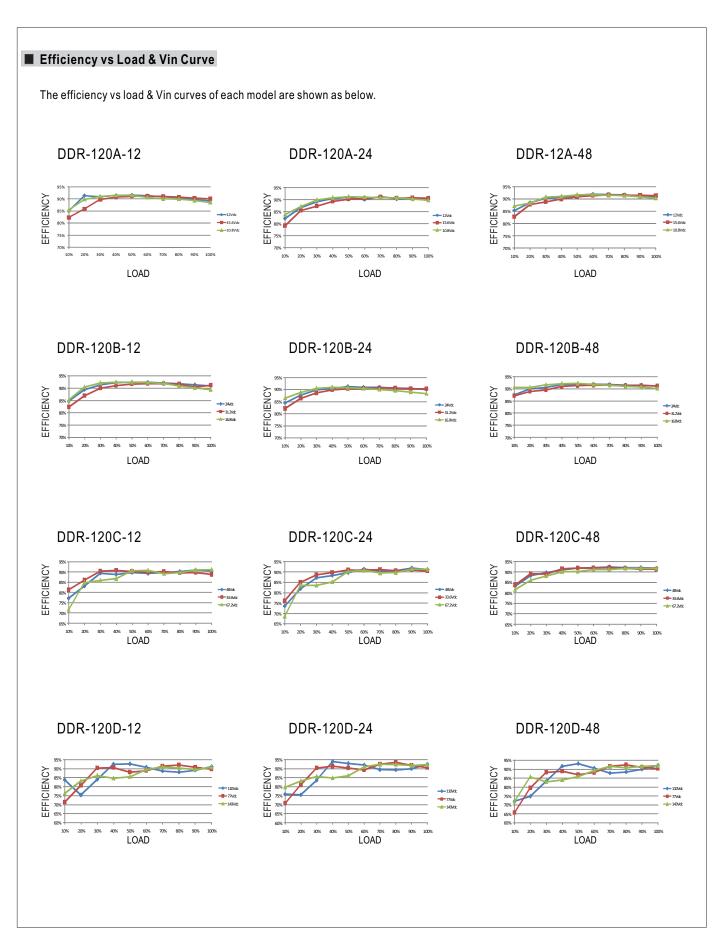





# ■ Immunity to Environmental Conditions

Test method	Standard	Test conditions	Status
Cooling Test	EN 50155 section 12.2.3 (Column 2, Class TX) EN 60068-2-1	Temperature: -40°C Dwell Time: 2 hrs/cycle	No damage
Dry Heat Test	EN 50155 section 12.2.4 (Column 2, Class TX) EN 50155 section 12.2.4 (Column 3, Class TX & Column 4, Class TX) EN 60068-2-2	Temperature: 70°C / 85°C Duration: 6 hrs / 10min	PASS
Damp Heat Test, Cyclic	EN 50155 section 12.2.5 EN 60068-2-30	Temperature: 25°C~55°C Humidity: 90%~100% RH Duration: 48 hrs	PASS
Vibration Test	EN 50155 section 12.2.11 EN 61373	Temperature: 19°C Humidity: 65% Duration: 10 mins	PASS
Increased Vibration Test	EN 50155 section 12.2.11 EN 61373	Temperature: 19°C Humidity: 65% Duration: 5 hrs	PASS
Shock Test	EN 50155 section 12.2.11 EN 61373	Temperature: $21\pm3^{\circ}\text{C}$ Humidity: $65\pm5\%$ Duration: $30\text{ms*}18$	PASS
Low Temperature Storage Test	EN 50155 section 12.2.3 (Column 2, Class TX) EN 60068-2-1	Temperature: -40°C Dwell Time: 16 hrs	PASS
Salt Mist Test	EN 50155 section 12.2.10 (Class ST4)	Temperature: 35°C ±2°C Duration: 96 hrs	PASS

## ■ EN45545-2 Fire Test Conditions


Test Iter	Test Items			Hazard Level		
	Items	Standard	HL1	HL2	HL3	
	Oxygen index test	EN 45545-2:2013 EN ISO 4589-2:1996	PASS	PASS	PASS	
R22	Smoke density test	EN 45545-2:2013 EN ISO 5659-2:2006	PASS	PASS	PASS	
	Smoke toxicity test	EN 45545-2:2013 NF X70-100:2006	PASS	PASS	PASS	
R24	Oxygen index test	EN 45545-2:2013 EN ISO 4589-2:1996	PASS	PASS	PASS	
R25	Glow-wire test	EN 45545-2:2013 EN 60695-2-11:2000	PASS	PASS	PASS	
R26	Vertical flame test	EN 45545-2:2013 EN 60695-11:2003	PASS	PASS	PASS	






## ■ Mechanical Specification


Case No. Unit:mm




Terminal Pin No. Assignment (TB2)

Pin No.	Assignment
1,2	DC Output -Vo
3,4	DC Output +Vo










 ${\sf ADMISSIBLE\ DIN-RAIL:TS35/7.5\ OR\ TS35/15}$ 



Bottom View

Terminal Pin No. Assignment (TB1)

Pin No.	Assignment	
1	FG ⊕	
2	DC Input -Vin	
3	DC Input +Vin	